SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Dept. of Health & Human Services
Div. Environmental Health, 11 SHS
(207) 287-2070 FAX (207) 287-4172

PROPERTY LOCATION

City, Town, or Plantation	LAMOINE
Street or Road	WALKER ROAD
Subdivision, Lot #	

OWNER/APPLICANT INFORMATION

Name (last, first, MI): JEWELL, DUANE — ■ Owner ☐ Applicant

Mailing Address of ■ Owner ☐ Applicant: 104 EASTBROOK ROAD, FRANKLIN, ME, 04634

Daytime Tel. # / email address: (207) 460-6241

>> CAUTION: LPI APPROVAL REQUIRED <<

Town/City LAMOINE Permit # 2007

Date Permit Issued 10.14.20 Fee $ 265 Double Fee Charged ( )

Local Plumbing Inspector Signature L.P.I. # 394

Fee: $ 265 state min. fee $ _____ Locally adopted fee

Copy: ☐ Owner ☐ Town ☐ State

The Subsurface Wastewater Disposal System shall not be installed until a Permit is issued by the Local Plumbing Inspector. The Permit shall authorize the owner or installer to install the disposal system in accordance with the application and the Maine Subsurface Wastewater Disposal Rules.

Municipal Tax Map # 4 Lot # 10 7

OWNER OR APPLICANT STATEMENT

I state and acknowledge that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Department and/or Local Plumbing Inspector to deny a permit.

Signature of Owner or Applicant — Date

CAUTION: INSPECTION REQUIRED

I have inspected the installation authorized above and found it to be in compliance with Subsurface Wastewater Disposal Rules Application. _____ (1st Date Approved)

Local Plumbing Inspector Signature — (2nd Date Approved)

PERMIT INFORMATION

TYPE OF APPLICATION
- ■ 1. First Time System
- ☐ 2. Replacement System

Type Replaced: _____

Year Installed: _____
- ☐ 3. Expanded System
  - ☐ a. Minor Expansion <25%
  - ☐ b. Major Expansion ≥ 25%
- ☐ 4. Experimental System
- ☐ 5. Seasonal Conversion

SIZE OF PROPERTY

1 ± ■ acres ☐ sq. ft.

SHORELAND ZONING

☐ Yes ■ No

THIS APPLICATION REQUIRES
- ■ 1. No Rule Variance
- ☐ 2. First Time System Variance
  - ☐ a. Local Plumbing Inspector Approval
  - ☐ b. State & Local Plumbing Inspector Approval
- ☐ 3. Replacement System Variance
  - ☐ a. Local Plumbing Inspector Approval
  - ☐ b. State & Local Plumbing Inspector Approval
- ☐ 4. Minimum Lot Size Variance
- ☐ 5. Seasonal Conversion Permit

DISPOSAL SYSTEM TO SERVE
- ■ 1. Single Family Dwelling Unit, No. of Bedrooms: 3
- ☐ 2. Multiple Family Dwelling , No. of Units: _____
- ☐ 3. Other: (SPECIFY) _____

Current Use: ☐ Seasonal ☐ Year Round ■ Undeveloped

DISPOSAL SYSTEM COMPONENT(S)
- ■ 1. Complete Non-engineered System
- ☐ 2. Primitive System (graywater & alt. toilet)
- ☐ 3. Alternative Toilet, specify: _____
- ☐ 4. Non-engineered Treatment Tank (only)
- ☐ 5. Holding Tank, _____ gallons
- ☐ 6. Non-engineered Disposal Field (only)
- ☐ 7. Separated Laundry System
- ☐ 8. Complete Engineered System(2000 gpd or more)
- ☐ 9. Engineered Treatment Tank (only)
- ☐ 10. Engineered Disposal Field (only)
- ☐ 11. Pre-treatment, specify: _____
- ☐ 12. Miscellaneous components

TYPE OF WATER SUPPLY

■ Proposed ☐ Existing

■ 1. Drilled Well ☐ 2. Dug Well ☐ 3. Private ☐ 4. Public ☐ 5. Other: _____

DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)

TREATMENT TANK
- ■ 1. Concrete
  - ■ a. Regular
  - ☐ b. Low Profile
  - ☐ c. with lift station
  - ☐ d. water tight
  - ☐ e. two compartment
- ☐ 2. Plastic
- ☐ 3. Other: _____

CAPACITY 1000 gallons

SOIL DATA & DESIGN CLASS

PROFILE 3 CONDITION C

at Observation Hole # 1

Depth 22 "

OF MOST LIMITING SOIL FACTOR

DISPOSAL FIELD TYPE & SIZE
- ■ 1. Stone Bed ☐ 2. Stone Trench
- ☐ 3. Proprietary Device _____
  - ☐ a. Cluster Array ☐ c. Linear
  - ☐ b. Regular load ☐ d. H-20 load
- ☐ 4. Other: _____

SIZE 900 ■ sq. ft. ☐ lin. ft.

DISPOSAL FIELD SIZING
- ☐ 1. Medium – 2.6 sq. ft./gpd
- ■ 2. Medium-Large – 3.3 sq. ft./gpd
- ☐ 3. Large – 4.1 sq. ft./gpd
- ☐ 4. Extra Large – 5.0 sq. ft./gpd

GARBAGE DISPOSAL UNIT

■ 1. No ☐ 2. Yes ☐ 3. Maybe

If Yes or Maybe, specify one below:
- ☐ a. Multi-compartment Tank
- ☐ b. _____ Tanks in Series
- ☐ c. Increase in Tank Capacity
- ☐ d. Filter on Tank Outlet

EFFLUENT/EJECTOR PUMP
- ■ 1. Not Required
- ☐ 2. May be Required
- ☐ 3. Required

Specify only for engineered systems

DOSE: _____ gallons

DESIGN FLOW

270 gallons per day

BASED ON
- ■ 1. Table 4A (dwelling unit(s)
- ☐ 2. Table 4C (other facilities)

SHOW CALCULATIONS for other facilities

- ☐ 3. Section 4G (meter readings) ATTACH WATER METER DATA

LATTITUDE AND LONGITUDE

at center of disposal area

Lat. 44° d 28' m 33.0" s N

Lon. 68° d 18' m 43.5" s W

If g.p.s., state margin of error 30'

SITE EVALUATOR STATEMENT

I certify that on 3-18-2020 (date) I completed a site evaluation on this property and state that the data reported are accurate and that the proposed system is in compliance with the State of Maine Subsurface Wastewater Disposal Rules (10-144A CMR 241).

Site Evaluator Signature — 319 SE# — 3-22-20 REV 4-22-20 Date

WILLIAM A. LaBELLE, JR. — Site Evaluator Name Printed

(207) 537-5900 — Telephone Number

labelleseptic@rivah.net — E-mail Address

Note: Changes to or deviations from the design should be confirmed with the Site Evaluator.

SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Dept. of Health & Human Services
Division of Environmental Health, 11 SHS
(207) 287-2070 FAX (207) 287-4172

Town, City, Plantation	Street, Road, Subdivision	Owner or Applicant Name
LAMOINE	WALKER ROAD	DUANE JEWELL

SITE PLAN — Scale 1" = 50 Ft.

(SEE ATTACHED SITE PLAN)

SITE LOCATION PLAN
(Attach map from Maine Atlas for First Time System Variance)

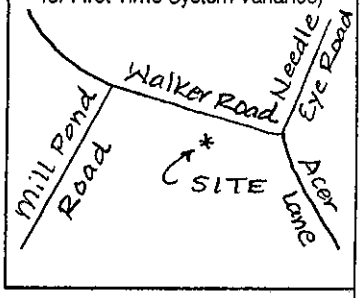

TABLE 7A

Reduction in setbacks between a Private Potable Water Supply and a disposal field with a design flow of less than 1,000 gpd

Depth of well casing or linear seal below ground level	Reduction in the minimum 100 ft. setback distance
>40 feet to 55 feet	100 down to 90 feet
>55 feet to 70 feet	100 down to 80 feet
>70 feet to 86 feet	100 down to 70 feet
>86 feet	100 down to 60 feet

SOIL PROFILE DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above or on pg. 2A)

Observation Hole #1 ■ Test Pit ☐ Boring

2 " Depth of organic horizon above mineral soil

Texture	Consistency	Color	Mottling
LOAMY GRAVELLY SAND	FRIABLE / FIRM IN PLACE	VERY DK. BROWN (10YR 2/2) / DARK YELLOWISH BROWN (10YR 4/6)	N.E.

DEPTH BELOW MINERAL SOIL SURFACE (inches): 10, 20, 30, 40, 50

Soil Profile	Classification Condition	Slope	Limiting Factor Depth	
3	C	1-4%	24"	☐ Ground Water ■ Restrictive Layer ☐ Bedrock ☐ Pit Depth

Observation Hole #1 ■ Test Pit ☐ Boring

2 " Depth of organic horizon above mineral soil

Texture	Consistency	Color	Mottling
Loamy Gravely Sand	Friable / Firm	10YR 2/2 / 10YR 4/6	N/E

DEPTH BELOW MINERAL SOIL SURFACE (inches): 10, 20, 30, 40, 50

Soil Profile	Classification Condition	Slope	Limiting Factor Depth	
3	C	2 %	24 "	☐ Ground Water ■ Restrictive Layer ☐ Bedrock ☐ Pit Depth

Site Evaluator's Signature — 319 S. E. # — 4-22-20 Date

Town, City, Plantation	Street, Road, Subdivision	Owner or Applicant Name
LAMOINE	WALKER ROAD	DUANE JEWELL

SITE PLAN:

SCALE: 1" = 50 FT.

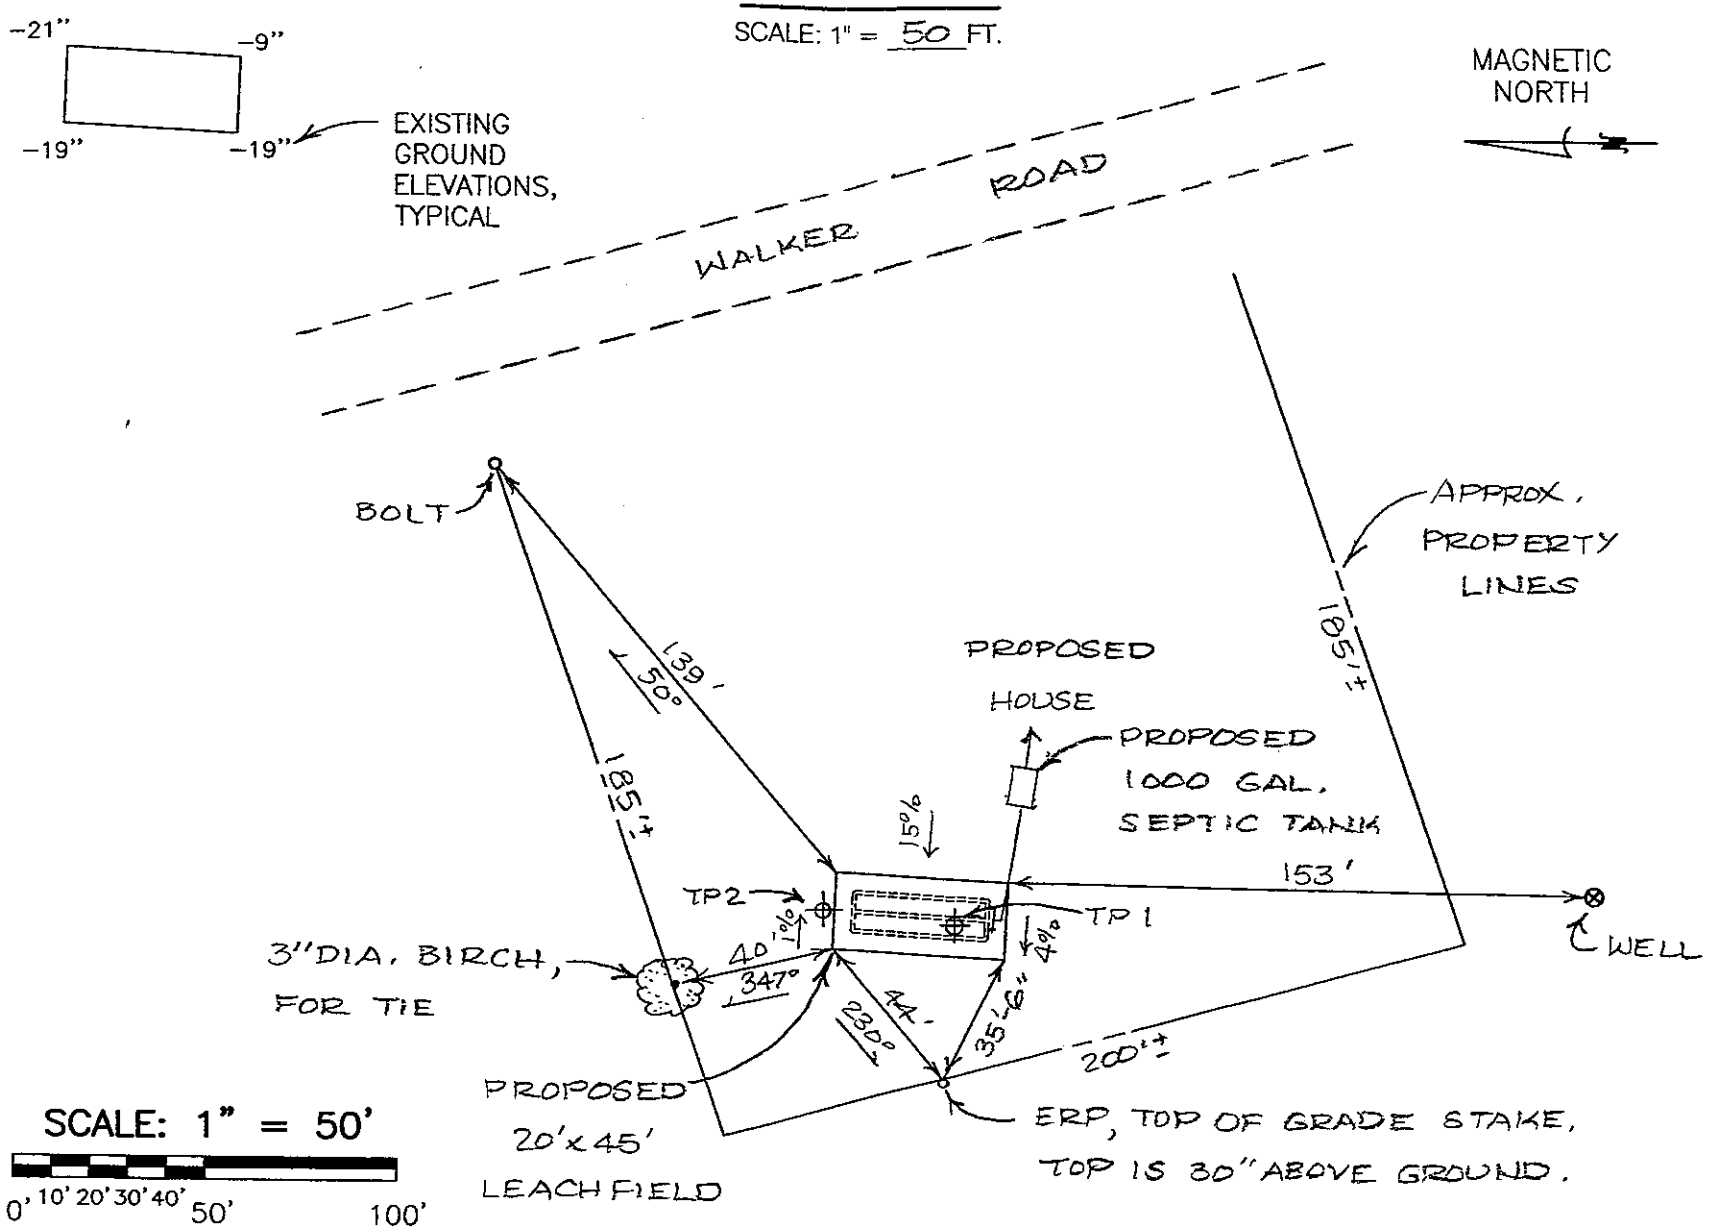

Site Evaluator's Signature	S.E. #	Date
	319	4-22-20

SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Dept. of Health & Human Services
Division of Environmental Health, 11 SHS
(207) 287-2070 FAX (207) 287-4172

Town, City, Plantation	Street, Road, Subdivision	Owner or Applicant Name
LAMOINE	WALKER ROAD	DUANE JEWELL

SUBSURFACE WASTEWATER DISPOSAL PLAN

SCALE: 1" = 20 FT.

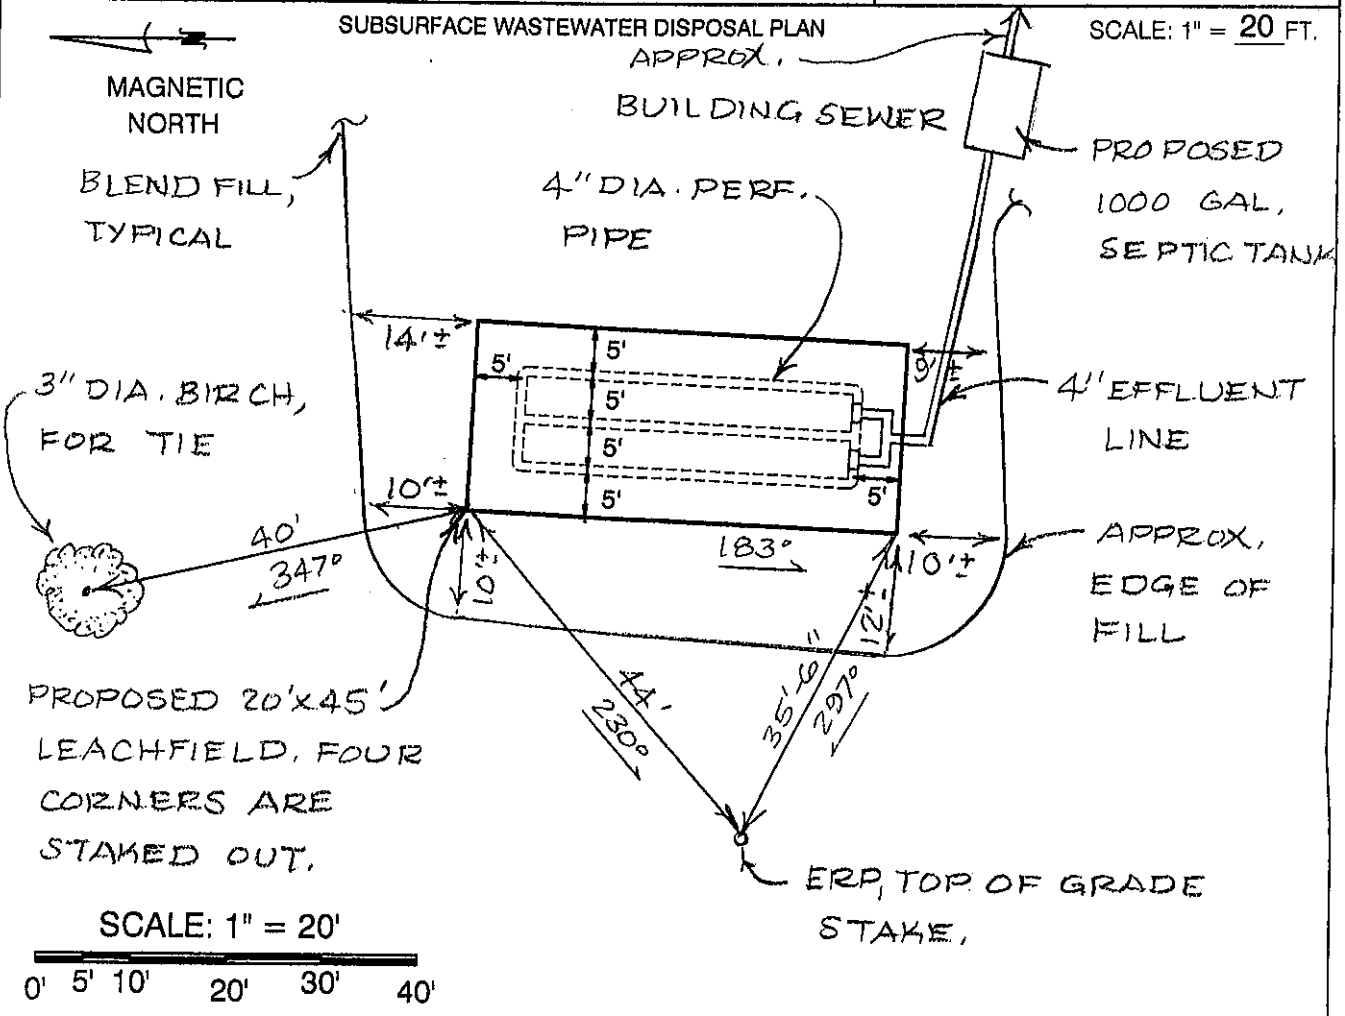

FILL REQUIREMENTS		CONSTRUCTION ELEVATIONS	SYSTEM:	PRIVY:	ELEVATION REFERENCE POINT
Depth of Backfill (Upslope)	19¼"-31¼"	Finished Grade Elevation	MIN. +3"		Location & Description: TOP OF GRADE STAKE, 30" ABOVE GROUND.
Depth of Backfill (Downslope)	22"	Top of Distribution Pipe or Proprietary Device	-8"	N/A	
Depths @ cross-section shown below or on X-sec. detail.		Bottom of Disposal Field	-19"		Reference Elevation is: 0"

NOTES: DISPOSAL AREA CROSS SECTION (SEE ATTACHED CROSS SECTION)

1. Tank(s) must be 8' minimum from building.
2. Grade surrounding area to divert surface water away from system.
3. Well to be 51' minimum from septic tank(s) and 100' minimum from disposal field.
4. All work done adjacent to wetlands, water bodies and water courses must be done in compliance with Section 12 of the Subsurface Wastewater Disposal Rules. Erosion and sediment control measures must be in accordance with the March 2003 edition of the Maine DEP Handbook "Maine Erosion and Sediment Control BMPS" (DEPW0588).
5. Install water tight risers of appropriate size to within 6" of finished grade on tank inlet, cleanout and outlet covers (recommend all to finish grade). Install water tight risers of appropriate size to finish grade on outlet tank covers, which house a filter, in-tank pump chambers and separate pump tanks. (Section 6-F of the subsurface code).
6. Full basement below grade foundation or frost wall must be 20' minimum from edge of disposal field and no full basement, slab, columns or posts must be 15' minimum from edge of disposal field.

Site Evaluator's Signature	S.E. #	Date
	319	4-22-20

DISPOSAL BED CROSS SECTION

NOTE:
GRADE UPSLOPE TO DIVERT SURFACE WATER AWAY FROM SYSTEM.

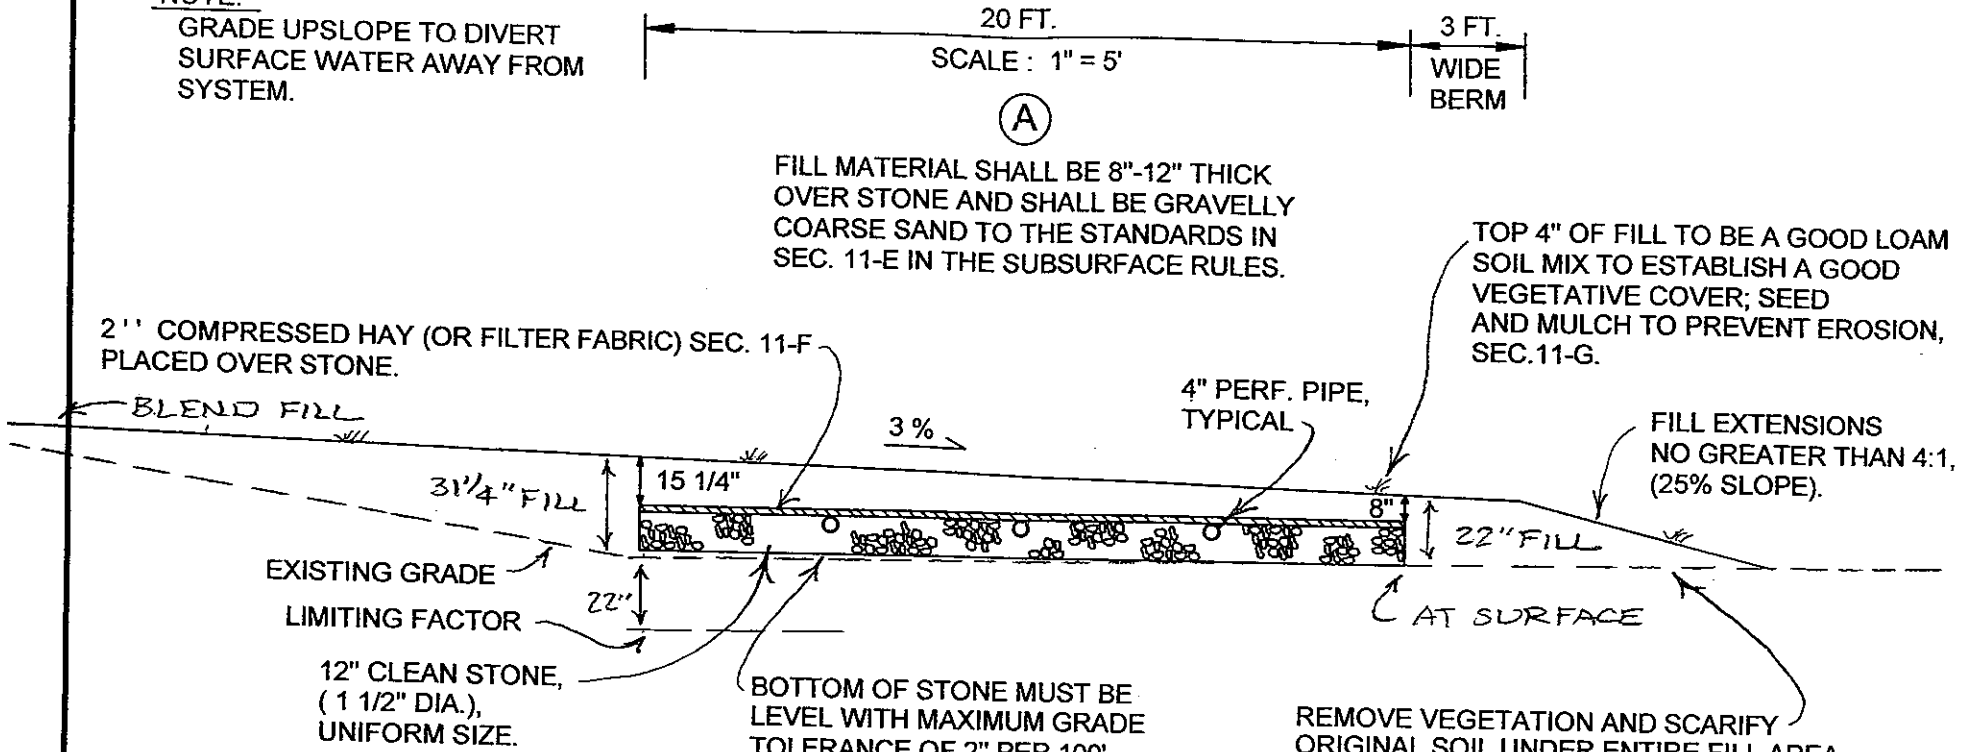

ELEVATIONS:

ELEV. REF. PT. (ERP):	0''
FINISHED GRADE:	+ 3" MIN.
TOP OF DISTRIBUTION PIPE:	- 8"
BOTTOM OF STONE:	-19"

SCALE: 1" = 5'
0' 1' 2' 3' 4' 5'

NOTE:
SYSTEM MUST BE INSTALLED ACCORDING TO THE RULES AND PRACTICES SET FORTH IN THE MOST CURRENT VERSION OF THE STATE OF MAINE SUBSURFACE WASTEWATER DISPOSAL RULES. INSTALLATION CONTRATOR MUST BE FAMILIAR WITH SAID RULES AND CONSTRUCT SYSTEM IN FULL COMPLIANCE WITH SECTION 11 OF SAID RULES.

OWNER: DUANE JEWELL

LOCATION: LAMOINE

WILLIAM A. LaBELLE, JR.

319
S.E.#

4-22-20
DATE

DOC20